


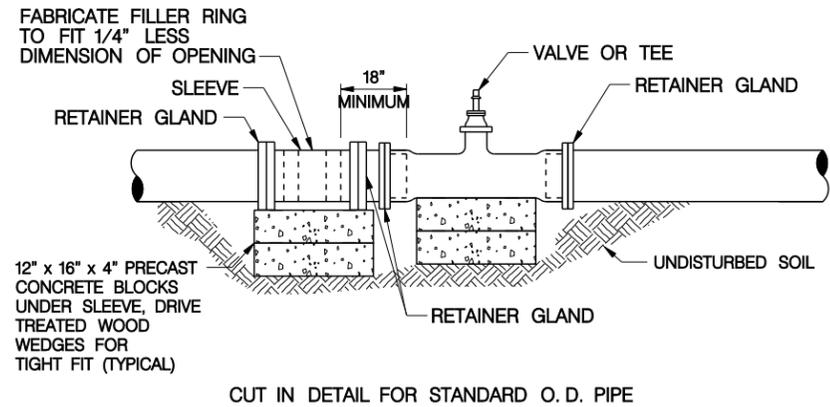
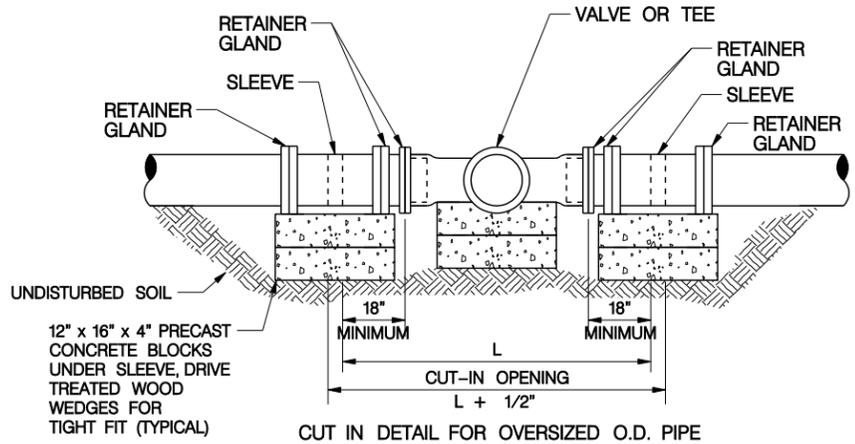


WATER TAPPING EXCAVATION PIT						
	A	B	C	D	E	F
TAPPING SLEEVE AND VALVE	12"	12"	6'-0"	10" OR LESS	8" MINIMUM	4'-0"
			7'-0"	12" OR LESS	9" MINIMUM	
WATER SERVICE TAP	6"	12"	3' MINIMUM	16" OR LESS	5'-0"	3'-0"
WASTEWATER SERVICE TAP	6"	12"	3' MINIMUM	15" OR LESS	5'-0"	3'-0"

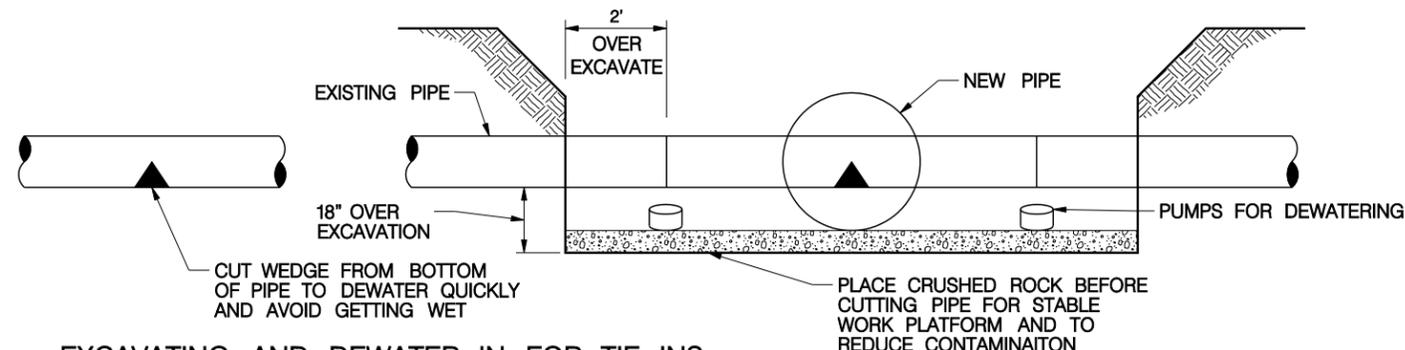

CHAMFER FOR 12" PVC BUTTERFLY VALVE

CUT IN FOR VALVES OR FITTINGS

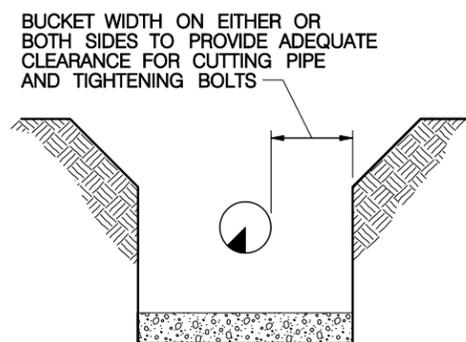

EXCAVATING AND DEWATER IN FOR TIE-INS LINCOLN WATER SYSTEM



EFFECTIVE JULY 1, 2011