# APPENDIX J

# XRF CORRELATION WITH LABORATORY RESULTS

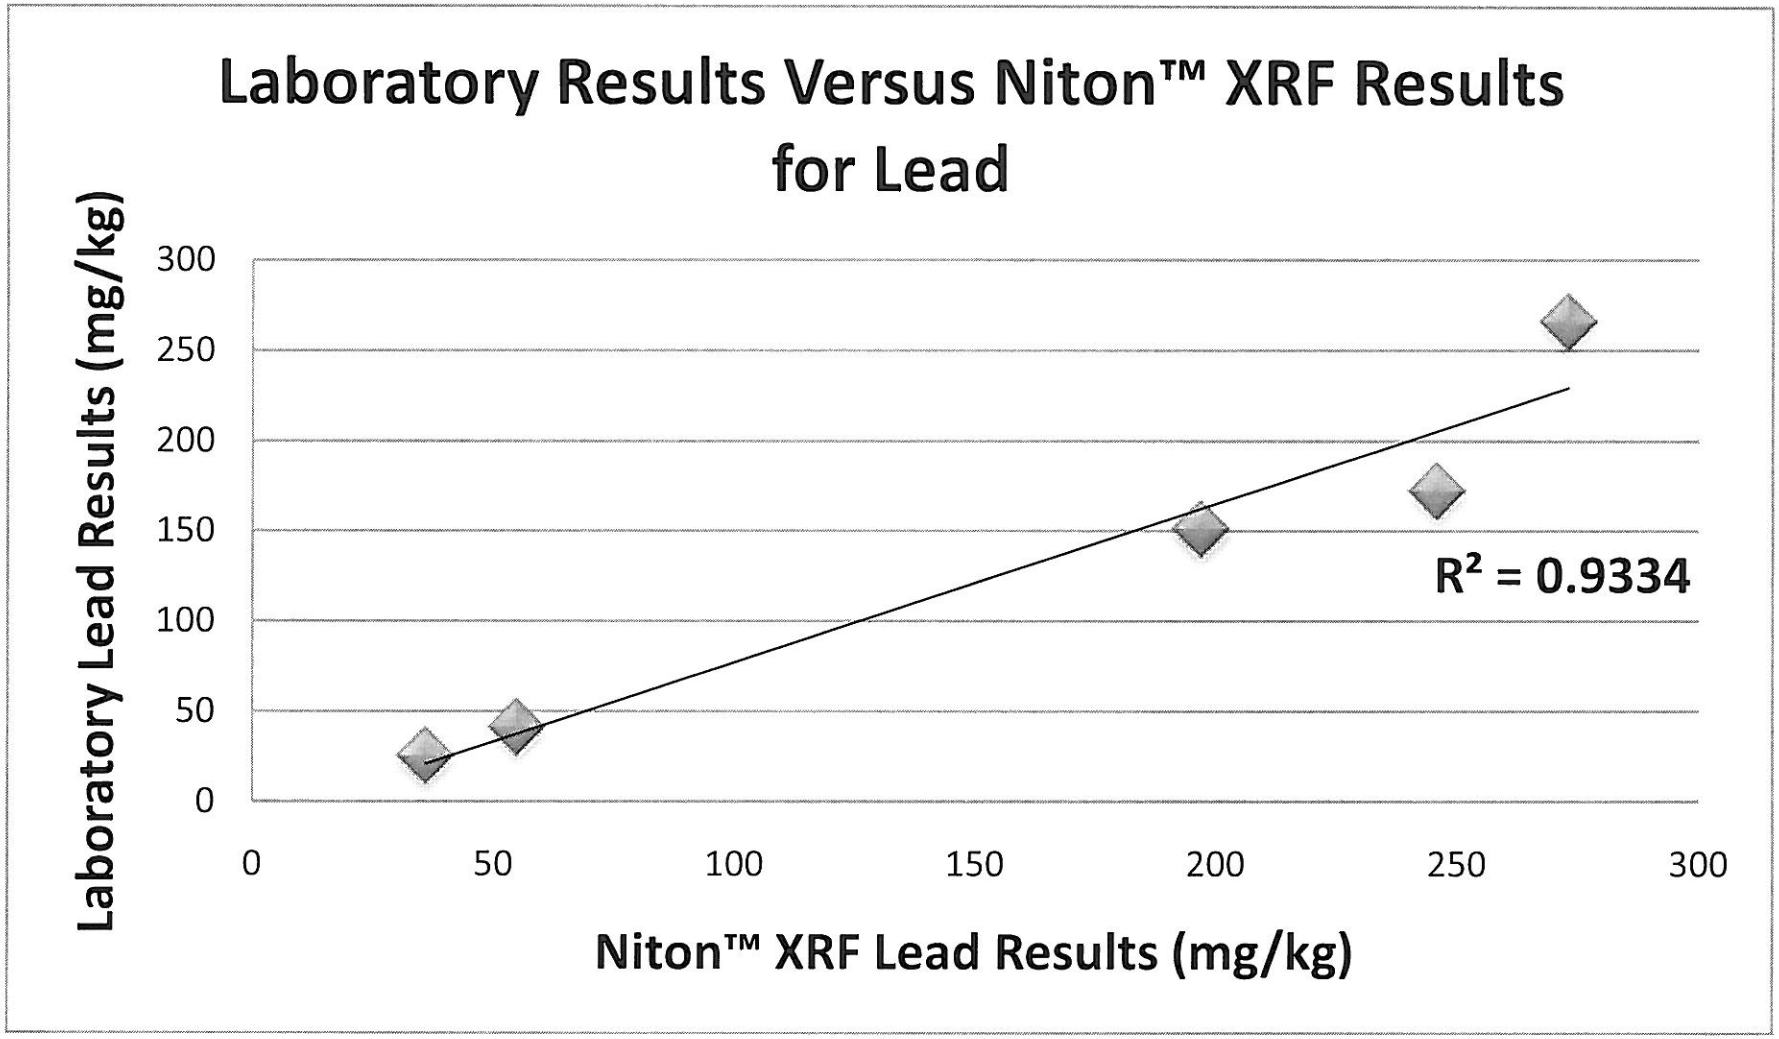
Laboratory Results Versus Niton™ XRF Results for Lead
Laboratory Lead Results (mg/kg)
300
250
200
150
100
50
0
0
50
100
150
200
250
300
Niton™ XRF Lead Results (mg/kg)
R² = 0.9334